


Health and remaining life for every asset.

GENESYS AMS & LES keeps one record per asset, scores its condition from tests, inspections, online monitoring and robot findings, and estimates its remaining life with the confidence band shown. Maintenance follows the condition, not the calendar.

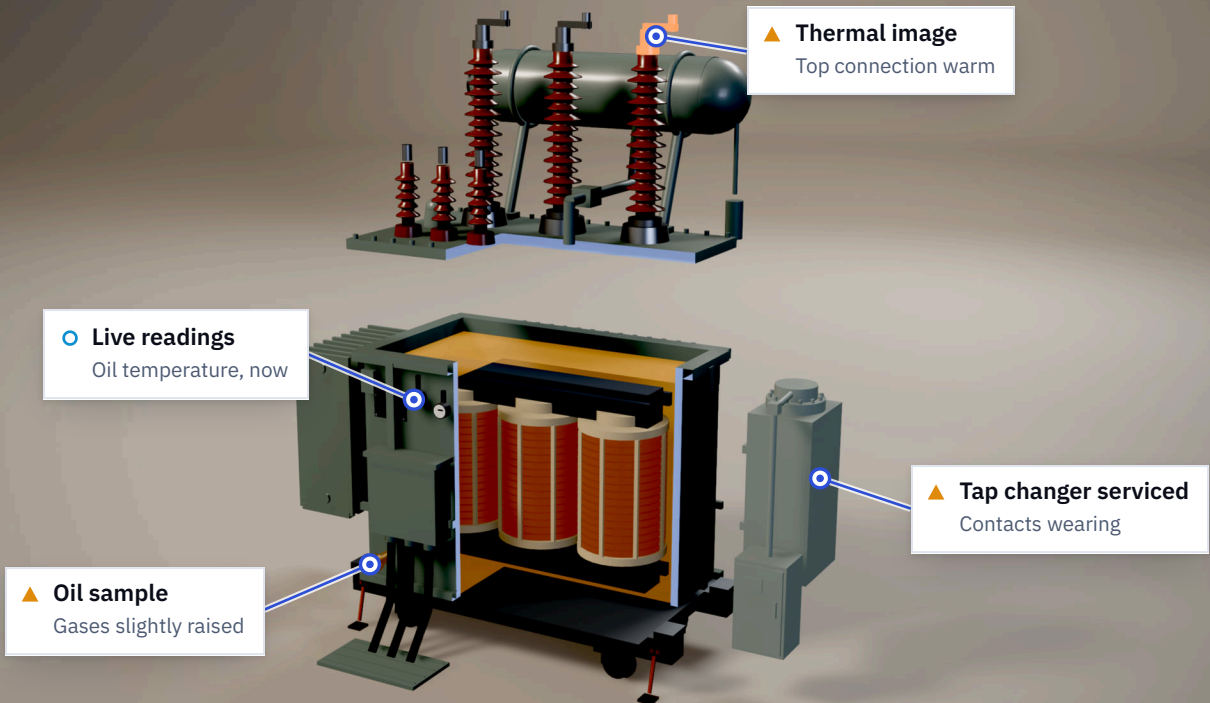

MAIN SUBSTATION	▲ Watch	Health index	Remaining life
Transformer, bay three		62 / 100	14.2 years
110/35 kV transformer		WATCH	80% BAND 11.8 TO 18.0 Y

Pilot it on a defined set of your own assets.


jumphash.com/genesys/ams-les · +387 33 714 925



SCAN FOR THE PAGE

LIFE ESTIMATION

Remaining life, with the error bars shown.

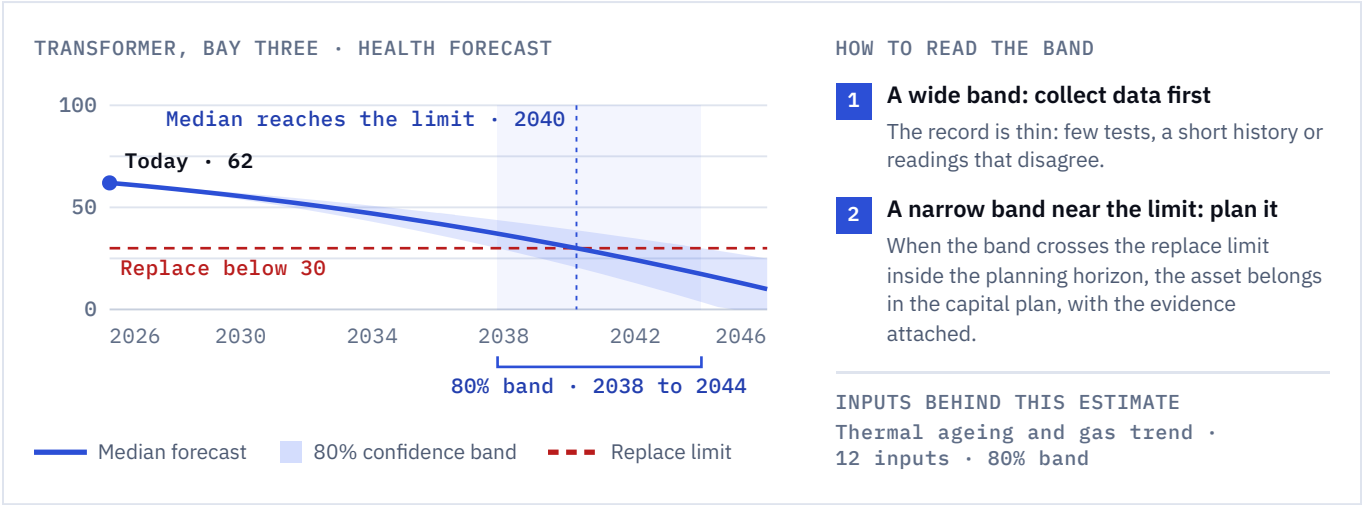

→ Plan the replacement window, not a guess.


FLEET VIEW AND PLAN

What needs attention first, and why.

FLEET BOARD · 152 ASSETS · 5 SITES

SITE	TRANSFORMERS	BREAKERS	LINES	RELAYS
Valley	▲ 4·1·0	◆ 10·3·2	▲ 5·1·0	▲ 12·2·0
Hilltop	▲ 3·1·0	◆ 7·2·1	◆ 4·2·1	▲ 9·2·0
Main substation	▲ 3·2·0	◆ 8·2·1	▲ 5·1·0	◆ 10·3·1
Riverside	◆ 2·1·1	◆ 5·2·1	▲ 3·1·0	▲ 7·2·0
North yard	▲ 1·1·0	▲ 4·1·0	● 3·0·0	◆ 7·1·1

● Good ▲ Watch ◆ Poor 4·1·0 = good · watch · poor; the shape shows the worst

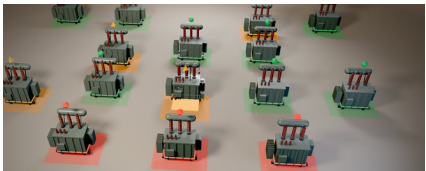

FROM THE BOARD TO THE PLAN

- 1 **See the whole fleet**
Every site and asset class in one matrix, with the worst state in each cell.
- 2 **Attention first**
Valley · breakers: 2 poor. One of them is the hill line breaker: health 38, 4.1 years left.
- 3 **Into the plan**
2026 Q4 · Hill line breaker, Valley substation: replace the gas seals and retest.
- ◆ Poor

→ Budgets go where they matter, and work is planned by condition, not by the calendar.




General Engineering d.o.o.
Safeta Zajke 183A, 71000 Sarajevo, Bosnia and Herzegovina
+387 33 714 925 · info@gene.ba
gene.ba · Mon to Fri, 08:00 to 17:00

3D people Microsoft Rocketbox (MIT). Environment assets Poly Haven (CC0).



JUMPHASH
Developer and co-investor
hello@jumphash.com
jumphash.com/genesys/partnership



jumphash.com/genesys/
ams-les